
LPCB[®]

www.redbooklive.com

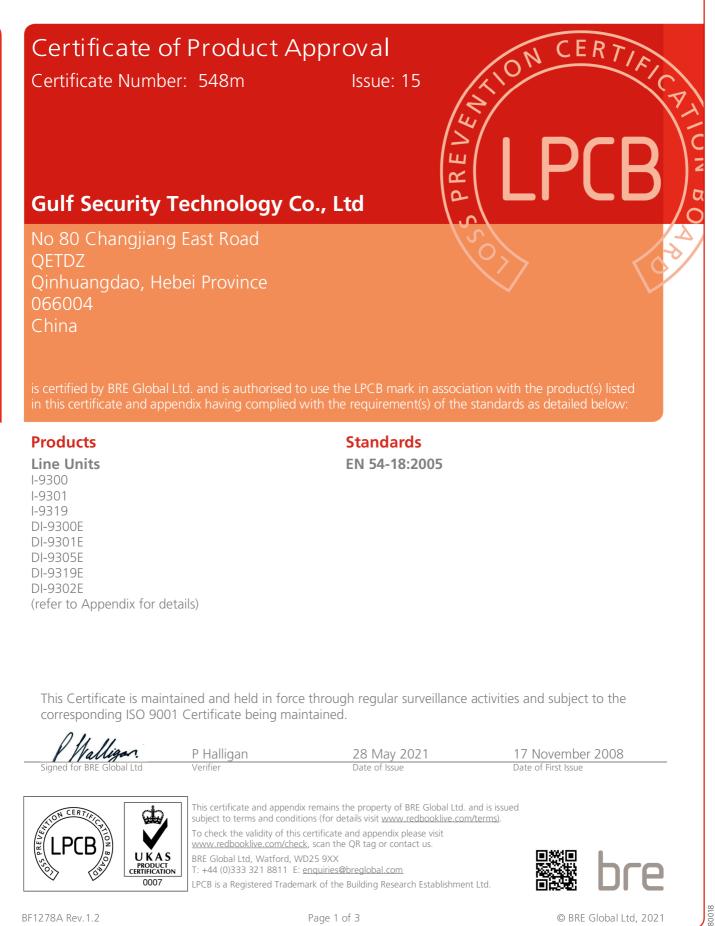

LPCB[®]

Appendix to Certificate No: 548m **Gulf Security Technology Co., Ltd**

LPCB Certified Description Product Ref.No. I-9300 Analogue Addressable Input Module 548m/01 Analogue Addressable Single Output Module I-9301 548m/02 Notes: 1. 4 Wire Mode, 24v active output (Default) 2. 2 Wire Mode, volt free changeover contact output I-9319 Addressable Zone Monitor Unit 548m/03 548m/04 DI-9300E Addressable Digital Single Input Module DI-9301E Addressable Digital Single Input and Output Module 548m/05 Addressable Digital Single Riser Output Module 548m/06 DI-9305E DI-9319E 548m/07 Addressable Digital Zone Monitor Unit DI-9302E Addressable Digital High Voltage Relay Module 548m/08

This Certificate is maintained and held in force through regular surveillance activities and subject to the corresponding ISO 9001 Certificate being maintained.

P Walligan.	P Halligan	28 May 2021	17 November 2008
Signed for BRE Global Ltd	Verifier Date of Issue Date of First Issue		Date of First Issue
LPCB CERTIFICATION LPCB CERTIFICATION UKAS PRODUCT CERTIFICATION	subject to terms and condi To check the validity of this		

LPCB is a Registered Trademark of the Building Research Establishment Ltd.

0007

Issue: 15

80018

LPCB[®]

Appendix to Certificate No: 548m **Gulf Security Technology Co., Ltd**

Issue: 15

Alternative Model No./Label

LPCB Ref No.	Model No.	Alternative Model No./Label	Cross-listed company	Cross-Listed Co Cert./ Ref No.
548m/01	I-9300	FX9300I	FIREX Protection System Technology Ltd	548m-(cl-3)
548m/01	I-9300	SEA-9300	SS Fire & Security SDN BHD	548m-(cl-6)
548m/02	I-9301	FX9301I	FIREX Protection System Technology Ltd	548m-(cl-3)
548m/02	I-9301	SEA-9301	SS Fire & Security SDN BHD	548m-(cl-6)
548m/03	I-9319	FX9319I	FIREX Protection System Technology Ltd	548m-(cl-3)
548m/03	I-9319	SEA-9319	SS Fire & Security SDN BHD	548m-(cl-6)
548m/04	DI-9300E	FXI9300E	FIREX Protection System Technology Ltd	548m-(cl-3)
548m/05	DI-9301E	FXI9301E	FIREX Protection System Technology Ltd	548m-(cl-3)
548m/06	DI-9305E	FXI9305E	FIREX Protection System Technology Ltd	548m-(cl-3)
548m/07	DI-9319E	FXI9319E	FIREX Protection System Technology Ltd	548m-(cl-3)

This Certificate is maintained and held in force through regular surveillance activities and subject to the corresponding ISO 9001 Certificate being maintained.

P Walligan.	P Halligan	28 May 2021	17 November 2008		
Signed for BRE Global Ltd	Verifier	Date of Issue	Date of First Issue		
SON CERTIFICA	This certificate and appendix remains the property of BRE Global Ltd. and is issued subject to terms and conditions (for details visit <u>www.redbooklive.com/terms)</u> .				
	To check the validity of this certificate and appendix please visit <u>www.redbooklive.com/check</u> , scan the QR tag or contact us.				
UKAS PRODUCT CERTIFICATION	BRE Global Ltd, Watford, V T: +44 (0)333 321 8811 E				

T: +44 (0)333 321 8811 E: enquiries@breglobal.com

LPCB is a Registered Trademark of the Building Research Establishment Ltd.

0007

80018