



DI-M9305

Digital Single Riser Output Module


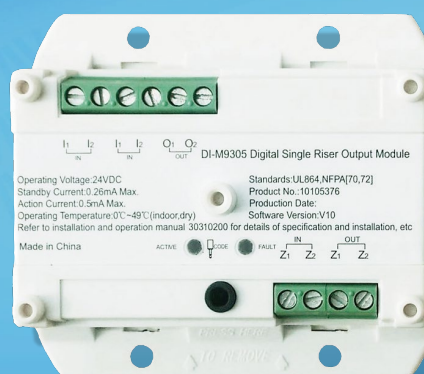


Description

DI-M9305 Digital Single Riser Output Module is designed to control the powering route, switches on and off the supply to end devices.

Features and Benefits

- Output port monitored with 47KΩ EOLR.
- Double-contact relay switching 2 lines together
- Electronically addressed. Addresses can be modified in field
- Rail mount or surface mount

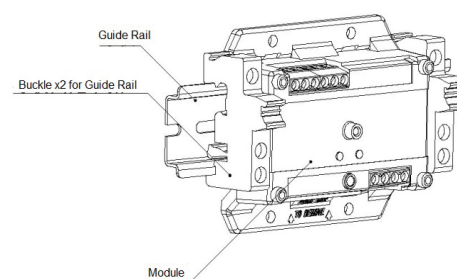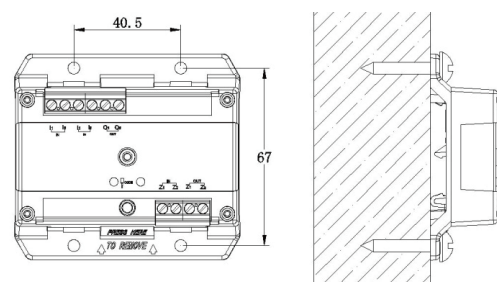

Certificates and Compliance

- Standards: UL864 / NFPA [70.72]
- Certifications: UL
- WEEE & RoHS Compliant

Installation

The installation points of the module are shown below, Wall-mount and Rail-mount. DIN-35mm rail is applicable.

Terminals and Recommended Cabling

(Z1, Z2) IN & OUT: Loop (SLC) connection, In & Out, non-polarized

(I1, I2) IN & OUT: Power source input terminals

O1, O2: Output terminals, polarity depends on connected device and input terminals

Recommended Cabling: Minimum 17 AWG, Maximum 14AWG twisted pair cable, and subject to local codes.

IMPORTANT: This publication is a generic version in which product information is shown for informational purposes only and does not constitute a specific commitment or guarantee. We are constantly pursuing the improvement of product technology to improve product performance, for which we reserve the right to adjust the configuration and technical information of the related products without notice. In addition, the description of system performance in this publication applies only to the usual situation. As a result, there may be a variety of unpredictable special circumstances in the real world, so the realization of the relevant product performance will depend on the professional investigation and analysis and the design plan. Please contact us and we will be happy to provide you with professional advice.


Application

The module is electronically programmable. Set the address and output parameter by handheld programmer P-9910B. The output line can be set monitored (default) or not.

Parameter (Function-3)	Input Mode
1	No
Other numbers (Default)	Yes

The operation can be done either through the clips-link to the terminals (Z1&Z2), or through the earphone-link to the 3.5mm code-jack.

A typical application connection is shown below. The polarity of O1O2 is same as I1I2.

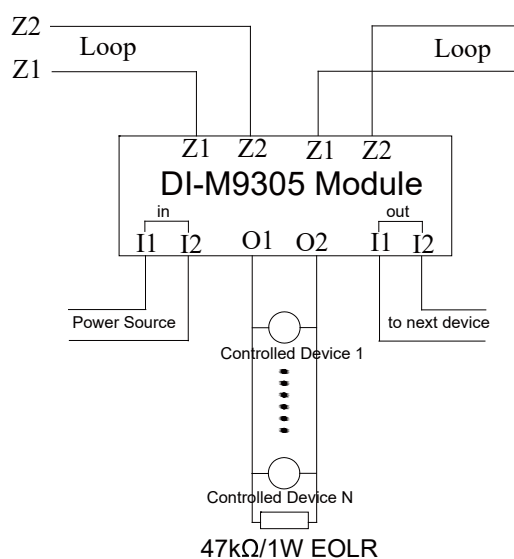

Technical Specification

Operating Voltage (Loop)	24VDC (16VDC - 28VDC) Power Limited
Power Voltage	Maximum 30VDC Power Limited
Standby Current	≤ 0.26mA (Loop)
Action Current	≤ 0.5mA (Loop)
Output Capacity	2A @ 30 VDC, 0.35PF
Programming	Electronically addressing
Address Range	1 address, from 1 to 242
Indicator	Feedback LED: RED, illuminates when the relay is activated, turns off as loop power cuts down, flashes in other states. Fault LED: Yellow, flashes 0.5s/on and 0.5s/off when output fault occurs, quiet in other states.
Ingress Protection Rating	IP30 (not tested by UL)
Operating Temperature	0°C ~ +49°C
Relative Humidity	≤ 93%, Non Condensing
Material and Color of Enclosure	ABS, white (RAL9016)
Dimension (L×W×H)	85.3mm×78mm×33mm
Weight	About 66.6g

Accessories and Tools



Part No.: P-9910B
Device name: Handheld Programmer
Product No.: 10104894

Order Information and Compatible Products

Part No.	DI-M9305
Device Name	Digital Single Riser Output Module
Product No.	10105376
Compatible Panel	GST-M200 Intelligent Fire Panel GST-IFP4M Intelligent Fire Panel

IMPORTANT: This publication is a generic version in which product information is shown for informational purposes only and does not constitute a specific commitment or guarantee. We are constantly pursuing the improvement of product technology to improve product performance, for which we reserve the right to adjust the configuration and technical information of the related products without notice. In addition, the description of system performance in this publication applies only to the usual situation. As a result, there may be a variety of unpredictable special circumstances in the real world, so the realization of the relevant product performance will depend on the professional investigation and analysis and the design plan. Please contact us and we will be happy to provide you with professional advice.