

GST-306

Extinguishing Control Panel



Description


GST306 Extinguishing Control Panel is designed for driving the executing units of a fixed extinguishing system. The panel sits in GST addressable loop, receives command from fire alarm control panel and carries out gas extinguishing.

Features and Benefits

- Directly connected to the loop of GST intelligent fire alarm control panels that are able to control associated fire suppression equipment to achieve automatic control of gas release.
- Through emergency gas override control in field or Start and Stop keys on the control panel, it can control gas release devices independent, even if the FACP is not working properly.
- All cables monitored for fault of open circuit and short circuit.
- Adjustable delay timer and release output period.
- Optional pulse or continuous output.

Installation Data


The GST306 Extinguishing Control Panel is wall-mount type. Its appearance and the mounting holes are shown here.

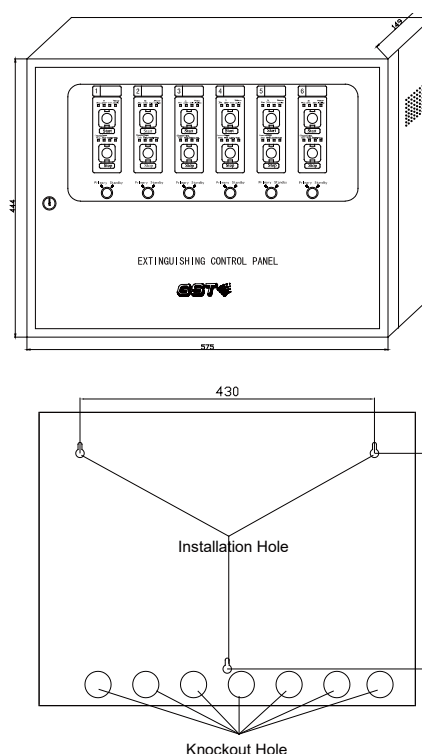

IMPORTANT: This publication is a generic version in which product information is shown for informational purposes only and does not constitute a specific commitment or guarantee. We are constantly pursuing the improvement of product technology to improve product performance, for which we reserve the right to adjust the configuration and technical information of the related products without notice. In addition, the description of system performance in this publication applies only to the usual situation. As a result, there may be a variety of unpredictable special circumstances in the real world, so the realization of the relevant product performance will depend on the professional investigation and analysis and the design plan. Please contact us and we will be happy to provide you with professional advice.

Terminals and Connections

All external wires are connected to the control panel through I/O board or filter. Below is the common terminal and terminals of Zone 1.

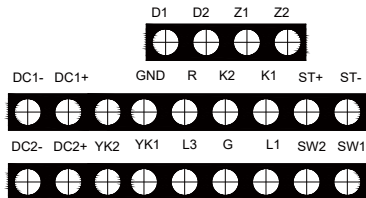

D1, D2: Power input, non-polarized.

Z1, Z2: Loop, non-polarized.

DC1-, DC1+: Extinguishing start terminal, to gas extinguishing relay module.

GND, R: Gas Extinguishing Warning Indicator.

K2, K1: To sounder strobe

DC2-, DC2+: Reserved for future use.


YK2, YK1: Pressure switch input, from gas extinguishing relay module.

L3, G, L1: Emergency Gas Override Control input

ST+, ST-: Gas Stop Indicator, polarized.

SW1, SW2: Door Switch input, from the switch of the door to the protected zone, non-polarized, normally-closed signal.

A typical system connection is shown below.

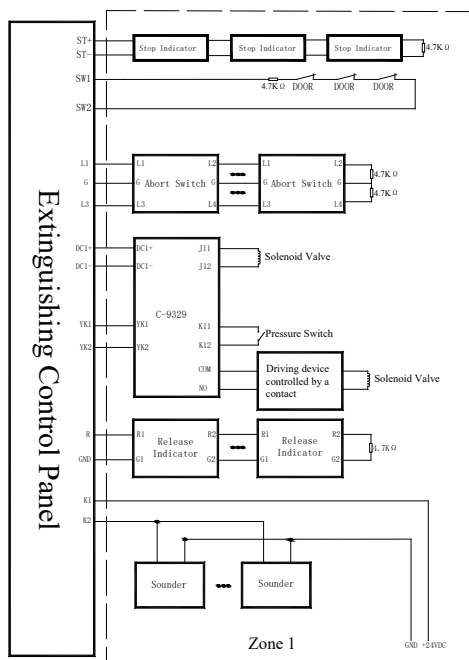

Technical Specification

| | |
|---------------------------|---|
| Operation Voltage | 24VDC |
| Standby Power Consumption | ≤10W |
| Zone Quantity | 6 |
| Delay timer | 0 ~ 45s, steps @5s |
| Gas Extinguishing Output | Pulse (5s) or Continuous output, Max. 2A |
| Other Outputs | Release Indicator: 300mA/24VDC Stop Indicator: 100mA/24VDC Sounder: Dry-contact, 1A/24VDC |
| Operating Environment | 0°C ~ +40°C ≤95%, non condensing |
| Dimensions | 575mm(W) x 444mm(H) x 149mm(D) |

Recommended cabling

All cables should be fire rated and follow local codes.

24VDC Power: 2.5mm², 100 meters

Cylinder: 2.5mm², 100 meters

Others: Minimum 1.0mm², ideally 1.5mm²

Ordering Information

| | |
|--------------------|--|
| Part No. | GST306 |
| Device Name | Extinguishing Control Panel |
| Product No. | 10104030 |
| Compatible Panels | GST200-2 GST200N GST-IFP8 |
| Compatible Devices | C-9317 Emergency Gas Override Control C-9318 Gas Extinguishing Warning Indicator C Series Conventional Detector DC Series Conventional Detector DC-9204E Conventional Manual Call Point C-9403 Conventional Sounder Strobe C-9404 Conventional Sounder |